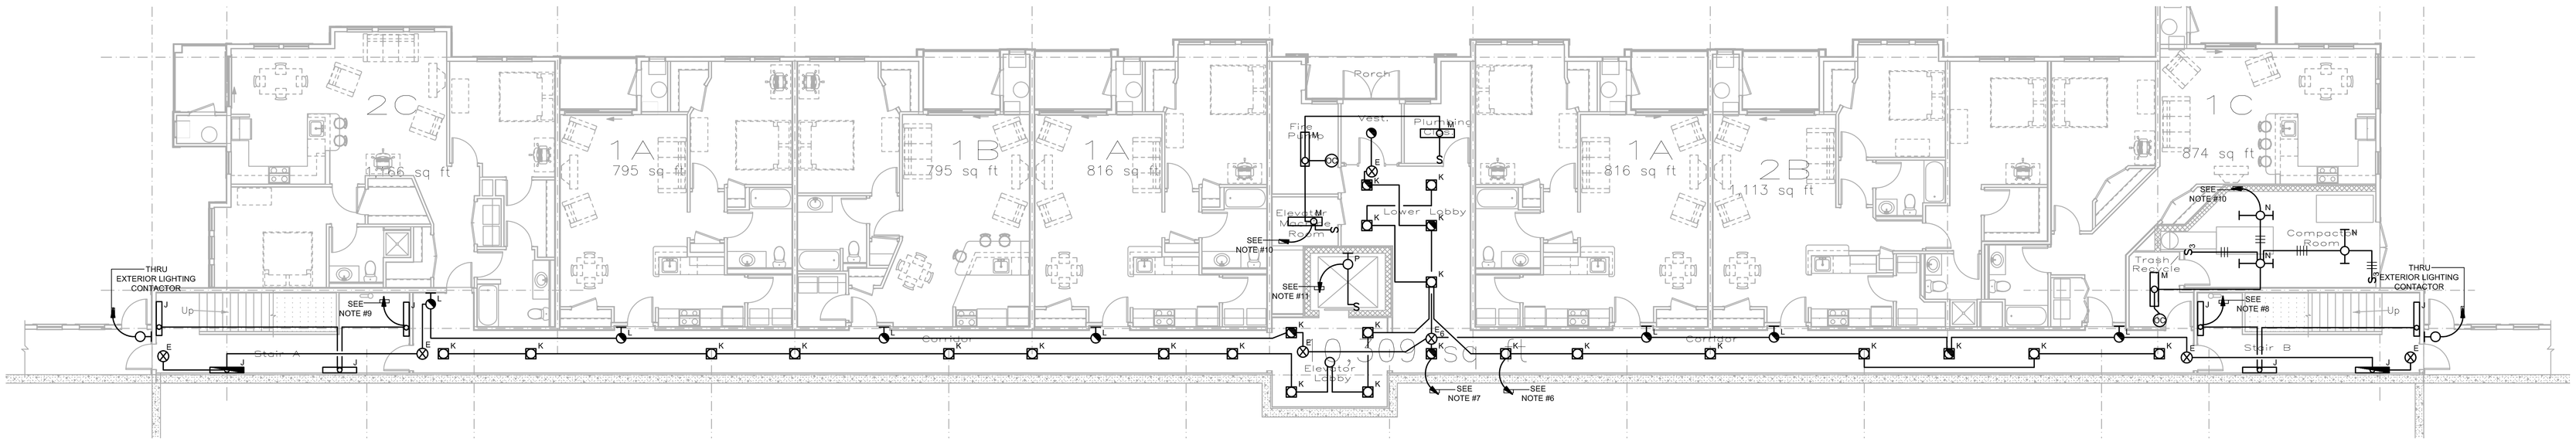

GROUND FLOOR LIGHTING PLAN

SCALE: 1/8" = 1'-0"

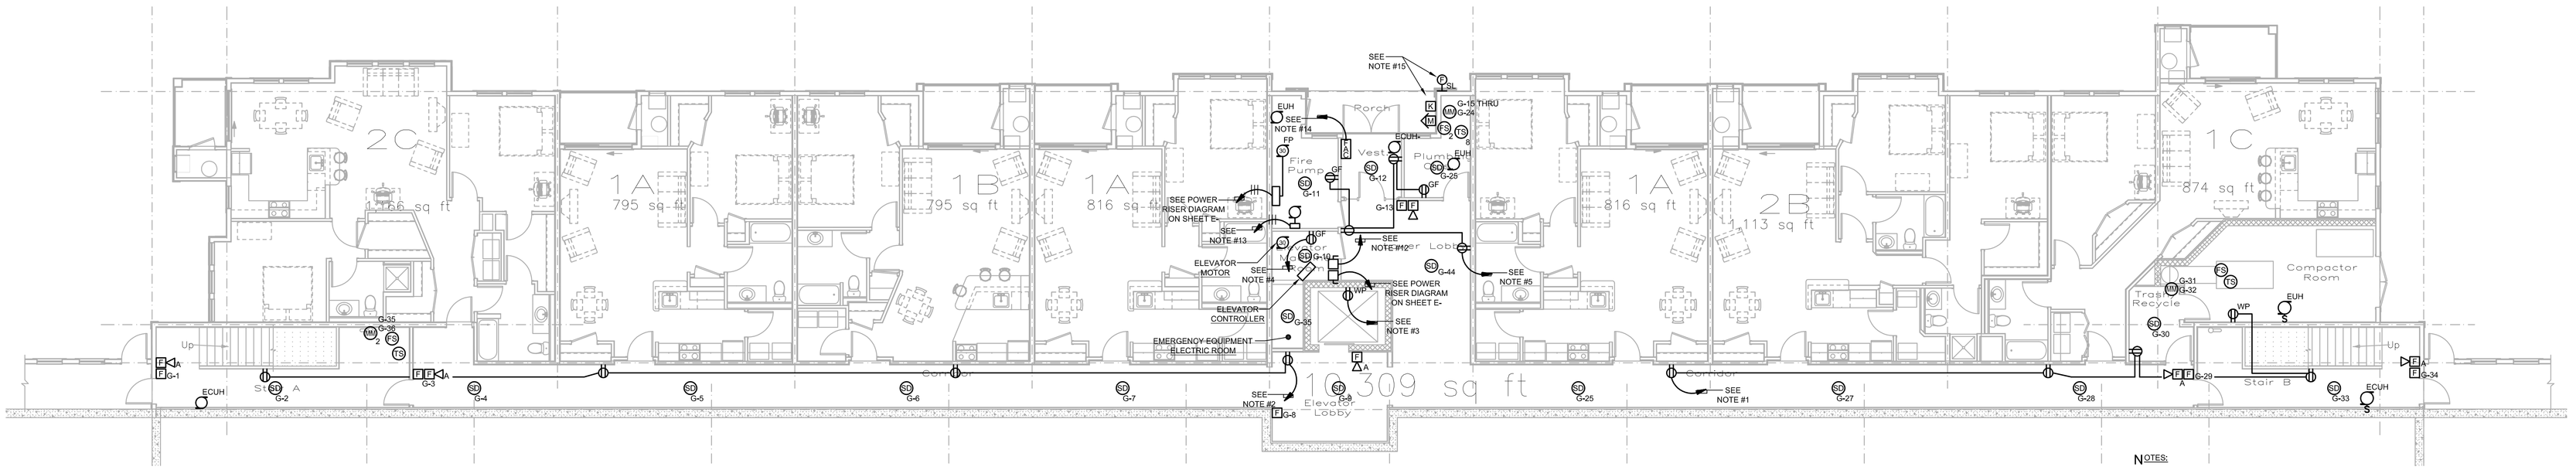

GROUND FLOOR ELECTRICAL PLAN

SCALE: 1/8" = 1'-0"

NOTES:

1. RECEPTACLES SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-1
   BUILDING NO.2 - HP2-1
   BUILDING NO.3 - HP3-1
2. RECEPTACLES SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-2
   BUILDING NO.2 - HP2-2
   BUILDING NO.3 - HP3-2
3. RECEPTACLES SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-3
   BUILDING NO.2 - HP2-3
   BUILDING NO.3 - HP3-3
4. RECEPTACLES SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-4
   BUILDING NO.2 - HP2-4
   BUILDING NO.3 - HP3-4
5. RECEPTACLES SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-5
   BUILDING NO.2 - HP2-5
   BUILDING NO.3 - HP3-5
6. LIGHTING FIXTURE SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-6
   BUILDING NO.2 - HP2-6
   BUILDING NO.3 - HP3-6
7. LIGHTING FIXTURE SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-7
   BUILDING NO.2 - HP2-7
   BUILDING NO.3 - HP3-7
8. LIGHTING FIXTURE SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-8
   BUILDING NO.2 - HP2-8
   BUILDING NO.3 - HP3-8
9. LIGHTING FIXTURE SHALL BE WIRED AS FOLLOWS:
   BUILDING NO.1 - HP1-9
   BUILDING NO.2 - HP2-9
   BUILDING NO.3 - HP3-9
10. LIGHTING FIXTURE SHALL BE WIRED AS FOLLOWS:
    BUILDING NO.1 - HP1-10
    BUILDING NO.2 - HP2-10
    BUILDING NO.3 - HP3-10
11. ELEVATOR CAB LIGHTING DISCONNECT SWITCH SHALL BE WIRED AS FOLLOWS:
    BUILDING NO.1 - HP1-11
    BUILDING NO.2 - HP2-11
    BUILDING NO.3 - HP3-11
12. JOCKEY PUMP CONTROLLER SHALL BE WIRED AS FOLLOWS:
    BUILDING NO.1 - HP1-12
    BUILDING NO.2 - HP2-12
    BUILDING NO.3 - HP3-12
13. FIRE ALARM CONTROL PANEL SHALL BE WIRED AS FOLLOWS:
    BUILDING NO.1 - HP1-13
    BUILDING NO.2 - HP2-13
    BUILDING NO.3 - HP3-13
14. THE EXACT LOCATION OF THE EXTERIOR FIRE ALARM STROBE LIGHT, MUNICIPAL MASTER BOX AND KNOX BOX SHALL BE VERIFIED BY THE ELECTRICAL CONTRACTOR, ARCHITECT AND LYNNFIELD FIRE DEPARTMENT IN THE FIELD.

JOHN M. CORCORAN & CO. LLC
LYNNFIELD COMMONS
LYNNFIELD, MASSACHUSETTS

GROUND FLOOR LIGTING & ELECTRICAL PLANS

Russell Scott Steedle & Capone Architects Inc.
18 Brattle Street • Cambridge • Massachusetts • 02138 • 617-661-5880 • Fax 661-0613

Date: 09-14-07
Scale: AS SHOWN

0514
E1
LYNNFIELD LBK